


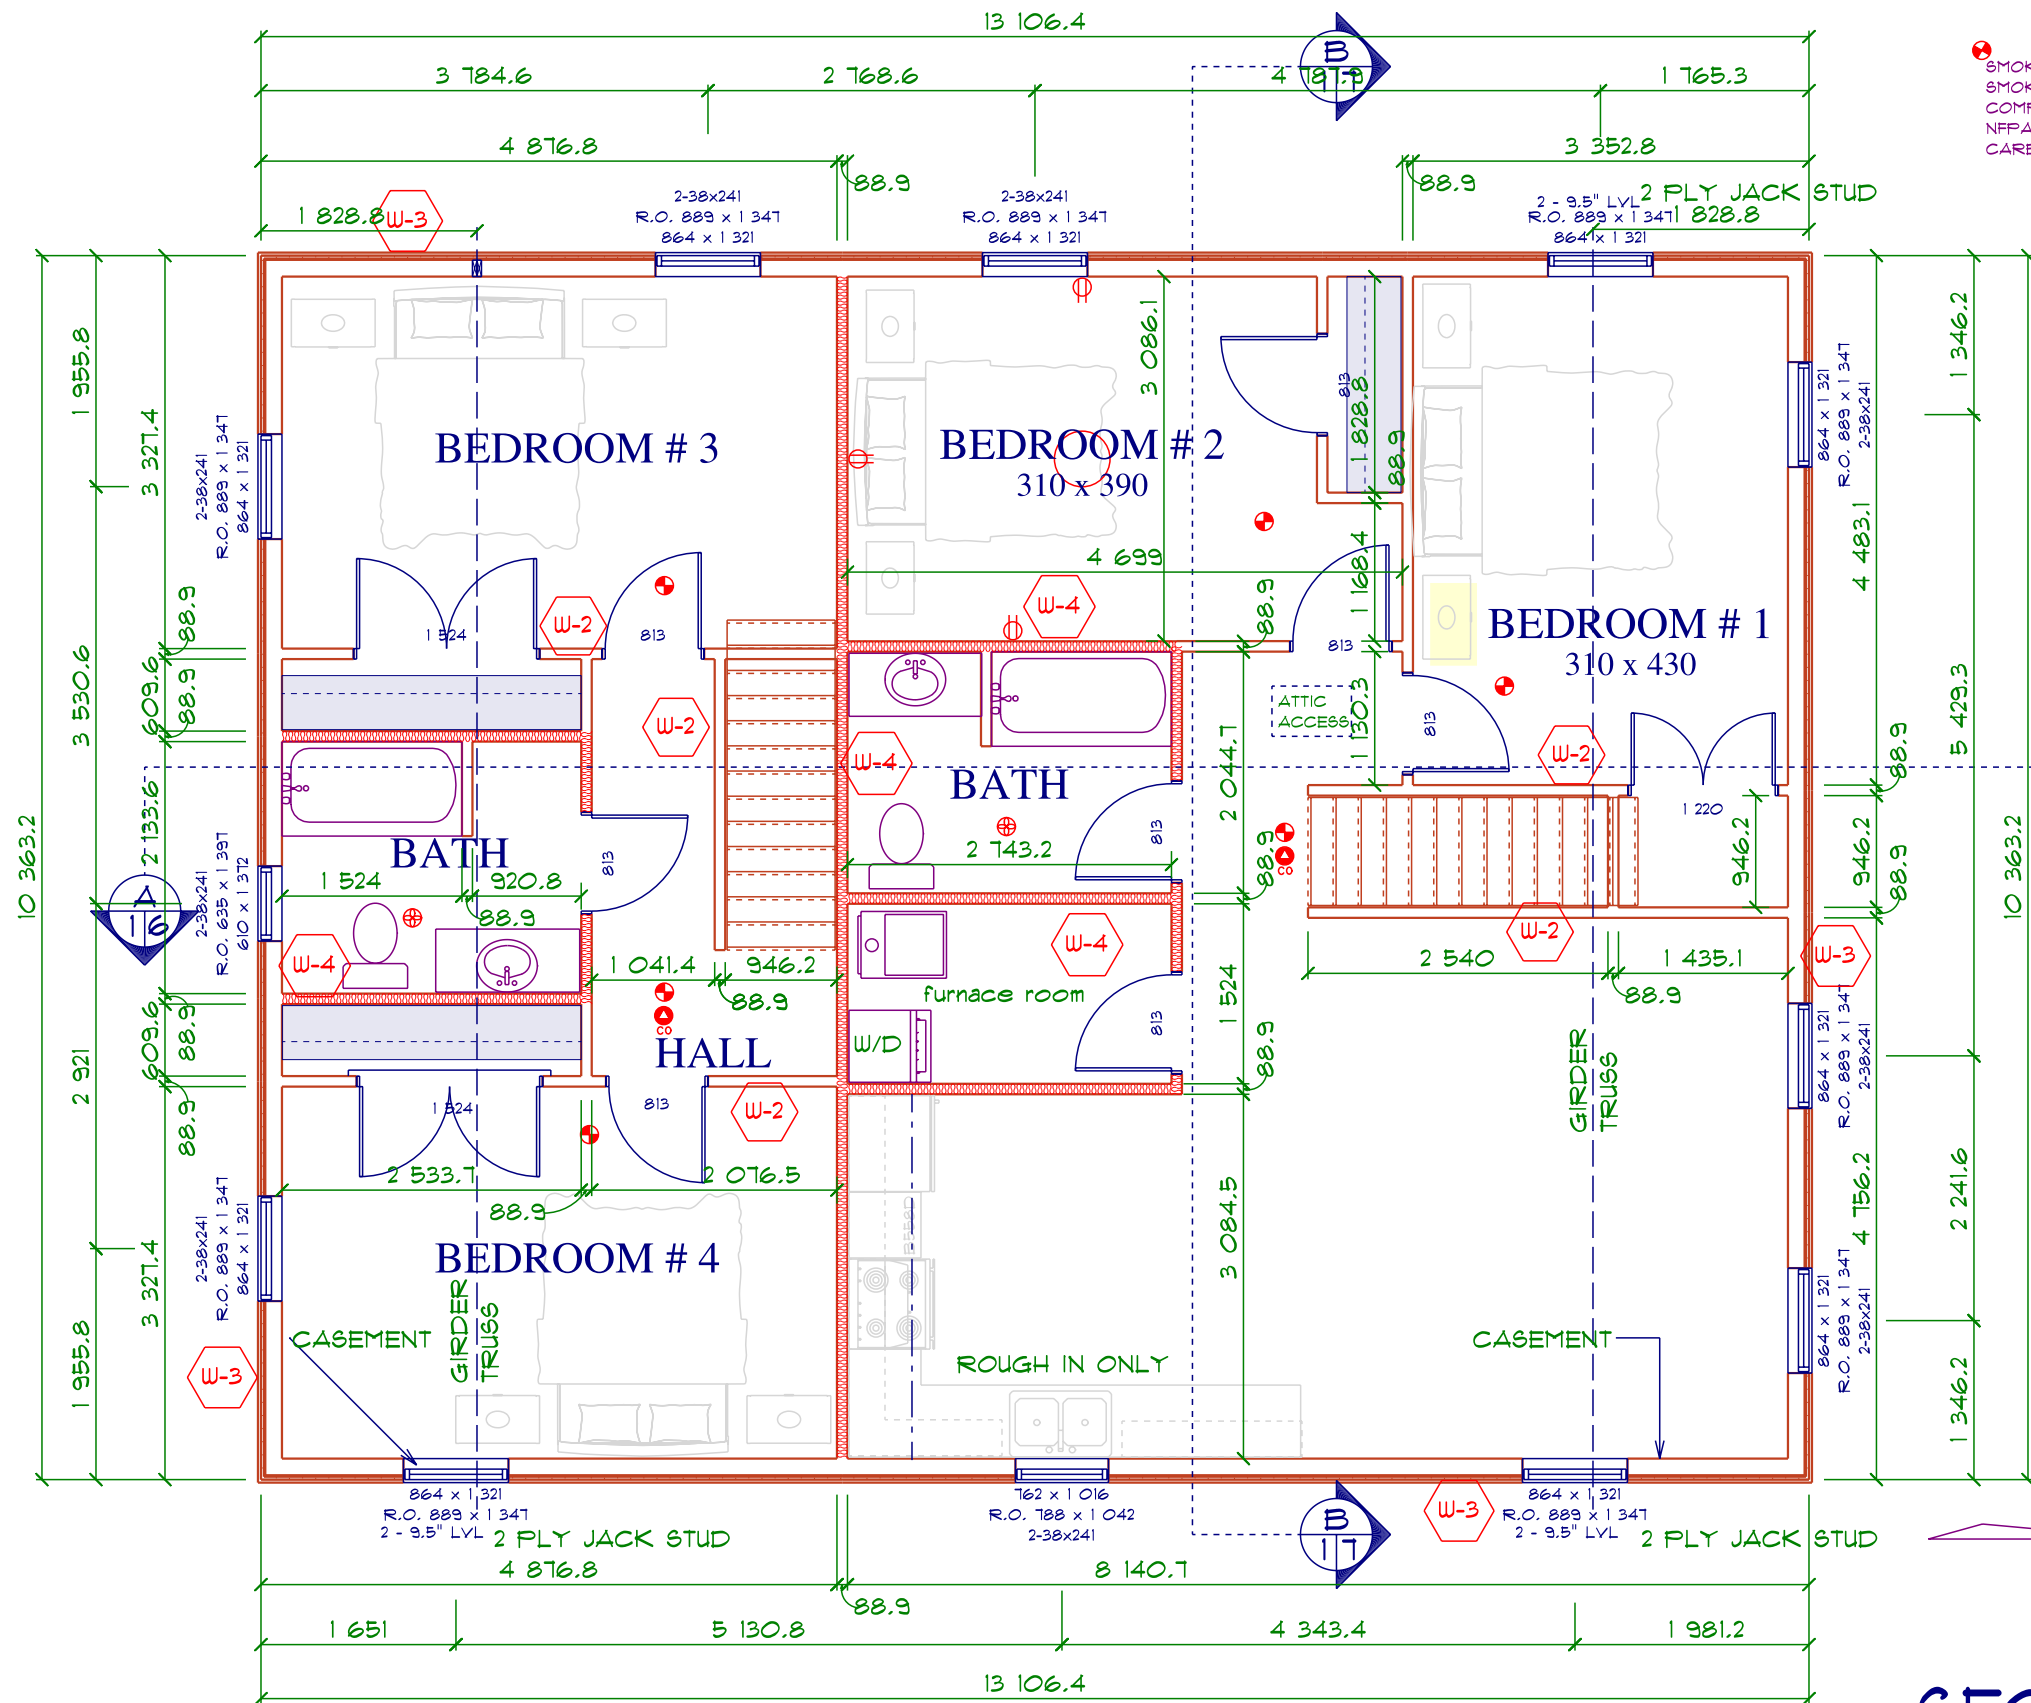

SMOKE ALARM AS PER B-9.10.19.1(2) O.B.C.
SMOKE ALARMS SHALL HAVE A VISUAL SIGNALLING COMPONENT CONFORMING TO THE REQUIREMENTS IN 18.5.3.
NFPA 72 NATIONAL FIRE ALARM AND SIGNALLING CODE
CARBON MONOXIDE DETECTORS AS PER B-9.33.4 O.B.C.

W:2
1/2" DRYWALL
2x4@16" O.C. STUD WALL
1/2" STANDARD DRYWALL

W:3
VINYL SIDING
TYPAR AIR BARRIER
1" RIGID INSULATION
7/16" O.S.B.
2x6@16" O.C. STUD WALL
R 20 BAT INSULATION
6 MIL. POLY
1/2" STANDARD DRYWALL

W:4
1/2" DRYWALL
2x4@16" O.C. STUD WALL
ABSORPTIVE MATERIAL
1/2" STANDARD DRYWALL

ATTIC ACCESS HATCH
NOT LESS THAN 22"x35"
TO BE WEATHER STRIPPED

SECOND FLOOR 2

SCALE: 1:64

Design - Build - General Contracting | Residential & Ag Construction
Office: 1020 Old Scout Place, Waterloo, ON N2J 4G8
Ph: 519.664.2642 • Fx: 519.664.3598
www.conestogocarpenters.ca
sales@conestogocarpenters.ca



Gerard Haley
55 Dublin Street
Guelph
Ontario
N1H-4M1
PHONE:
FAX:

SECTION LETTER
A
11
PAGE NUMBERS

DESIGNER INFORMATION
THE UNDERSIGNED HAS REVIEWED AND TAKES DESIGN RESPONSIBILITIES FOR THIS DESIGN, AND HAS THE QUALIFICATIONS SET OUT IN THE BUILDING CODE TO BE A DESIGNER
MARVIN HORST B.C.I.N.#34451
MARVIN HORST DESIGNS FIRM #36508

DRAWN BY: M.H.,
SCALE: 1:64
DATE: March 3, 2020

PAGE: 3/10
S3